


ID1	ID2	Type				No. Spec	Est. Comp
N4594	M104	G (Sa)				15	8%
[dir/date]	[medRA]	[medDEC]	[PA]	[dRA]	[dDEC]	[SCAN]	[N]
2011_03_03_04	12:40:30.00	-11:30:49.70	90.0	-4.4	7.9	E2W-N2S	6
2011_03_04_05	12:40:30.10	-11:30:31.80	90.0	-4.4	9.0	E2W-N2S	9

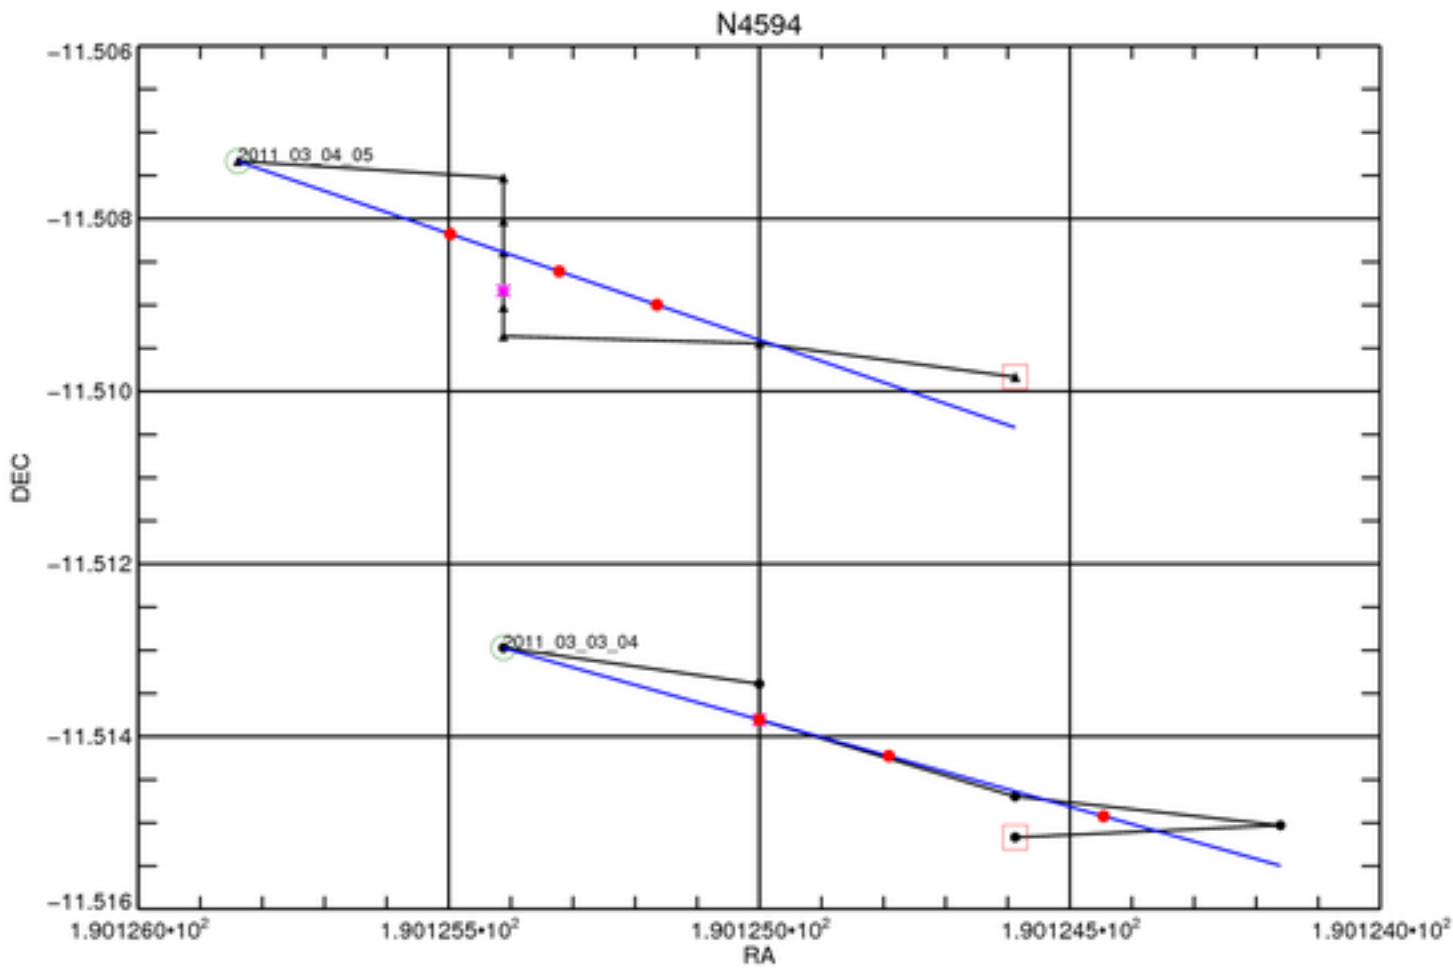


night, order, rascan, decscan

2011_03_03_04 0 -1 1

2011_03_04_05 1 -1 1

N4594 VIS 2011 03 03 04

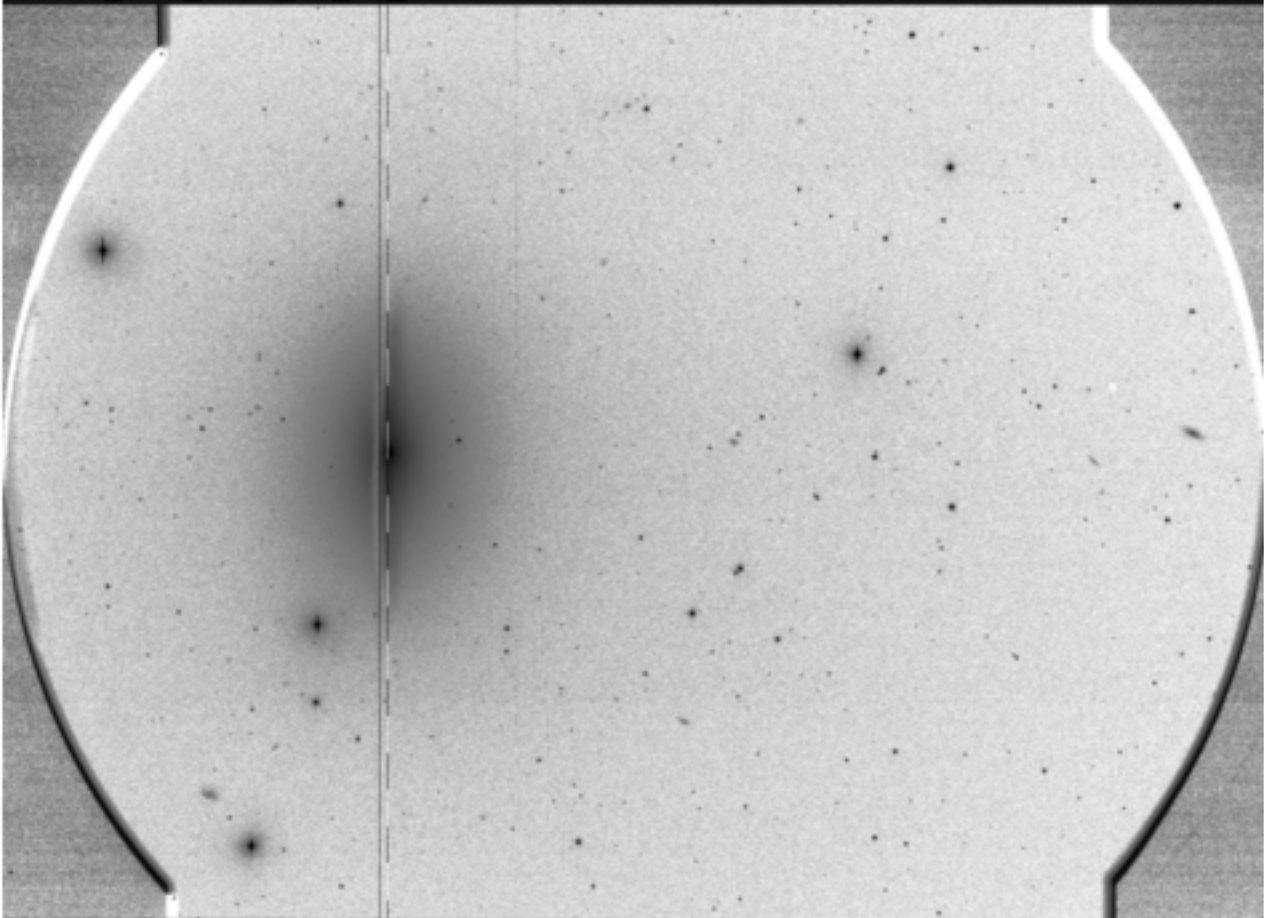

N4594 VIS 2011 03 04 05

